

IMPORTANT SAFETY INSTRUCTIONS - SAVE THESE INSTRUCTIONS

Installation instructions for KREON - SMALL DIAPASON on-track LED, gear inclusive, type: ku92640_

! WARNING - READ ALL INSTRUCTIONS - UNDERSTAND ALL INSTRUCTIONS BEFORE STARTING INSTALLATION - SAVE THESE INSTRUCTIONS FOR FUTURE REFERENCE

! ENSURE THE LUMINAIRE IS GROUNDED RISK OF FIRE! - RISK OF SHOCK!
- INSTRUCTIONS PERTAINING TO A RISK OF FIRE OR INJURY TO PERSONS
THIS LUMINAIRE MUST BE INSTALLED TO CONFIRM WITH NEC AND ALL LOCAL ELECTRICAL & BUILDING CODES & PRACTICES.
TO ASSURE FULL COMPLIANCE

WITH LOCAL CODES AND REGULATIONS, CONSULT WITH YOUR LOCAL ELECTRICAL INSPECTOR BEFORE INSTALLATION.
- DISCONNECT POWERSUPPLY BEFORE INSTALLING OR SERVICING
- LUMINAIRE IS SURFACE MOUNTED ONLY
- SUITABLE FOR DAMP LOCATIONS

- IN CASE OF A 120V FITTING: FOR USE WITH EUTRAC 230 TRACK SYSTEM ONLY
- IN CASE OF A 277V FITTING: FOR USE WITH EUTRAC 242 TRACK SYSTEM ONLY
- CAUTION - TO REDUCE RISK OF A BURN DURING RELAMPING, REMOVE LUMINAIRE FROM TRACK BEFORE RELAMPING
- LUMINAIRE IS SURFACE MOUNTED

1 notifications

ONLY
- DO NOT INSTALL ANY PART OF THE TRACK SYSTEM LESS THAN 5ft ABOVE THE FLOOR
- DO NOT ATTEMPT TO ENERGIZE ANYTHING OTHER THAN LIGHTING TRACK FIXTURES ON THE TRACK
- TO REDUCE THE RISK OF FIRE AND ELECTRIC SHOCK, DO NOT ATTEMPT TO CONNECT POWER TOOLS, EXTENSION CORDS, APPLIANCES, AND THE LIKE TO THE TRACK

WARNING - to reduce the risk of FIRE OR INJURY:
- turn off power and allow to cool before replacing lamp
- lamp gets HOT quickly! contact only switch/plug when turning on
- do not touch hot lens, guard, reflector or enclosure
- keep lamp away from materials that may burn
- this luminaire can only be used with Kreon accessories

This installation manual might not cover all details or variations. When additional information is required, please contact your local representative, or one of the Kreon offices.

Cette notice de montage ne couvre pas tous les détails ou les variations. Pour des informations supplémentaires veuillez contacter votre représentant local ou un des bureaux Kreon.

Notice de montage pour KREON - SMALL DIAPASON on-track LED, auxiliaire inclus, type: ku92640_

! ATTENTION - LIRE ET COMPRENDRE TOUTES LES INSTRUCTIONS AVANT L'INSTALLATION - CONSERVER CES INSTRUCTIONS POUR DE FUTURES REFERENCES

! RISQUE D'INCENDIE! RISQUE DE CHOC!


- INSTRUCTIONS RELATIVES À UN RISQUE D'INCENDIE OU DE BLESSURE
- CE PRODUIT DOIT ETRE INSTALLÉ SELON LE CODE D'INSTALLATION PERTINENT, PAR UNE PERSONNE QUI CONNAIT BIEN LE PRODUIT ET SON FONCTIONNEMENT AINSI QUE LES RISQUES INHERENTS
- CONSULTER UN ÉLECTRICIEN QUALIFIÉ POUR VOUS ASSURER QUE LES CONDUCTEURS DE LA DÉRIVATION SONT ADÉQUATS
- COUPER L'ALIMENTATION AVANT L'ENTRETIEN

- MONTER LE LUMINAIRE EN SURFACE SEULEMENT
- CONVIENT AUX EMPLACEMENTS HUMIDES
- ASSURER QUE LE LUMINAIRE EST MIS À LA TERRE
- EN CAS DE 120V LUMINAIRE: UTILISER SEULEMENT AVEC EUTRAC 230 TRACK SYSTEM
- EN CAS DE 277V LUMINAIRE: UTILISER SEULEMENT AVEC EUTRAC 242 TRACK SYSTEM
- ATTENTION - POUR REDUIRE LES RISQUES D'


INCENDIE DURANT LE CHANGEMENT DES LAMPES, RETIRER LE LUMINAIRE DU RAIL AVANT D'Y PROCEDER
- NE PAS INSTALLER UNE PARTIE DU RAIL A MOINS DE 5ft AU DESSUS DU SOL
- NE PAS ESSAYER DE CONNECTER SUR LE RAIL AUTRE CHOSE QU'UN APPAREIL D'ECLAIRAGE POUR RAIL
- POUR REDUIRE LES RISQUES ELECTRIQUES ET D'INCENDIE, NE PAS ESSAYER DE CONNECTER DES OUTILS ELECTRIQUES, RALLONGES, ETC... AU RAIL

ALERTE - pour réduire le risque D'INCENDIE OU DE BLESSURE:
- coupez l'alimentation électrique et laissez refroidir avant de remplacer l'ampoule
- la lampe chauffe rapidement!
- ne touchez pas l'objectif à chaud, la garde, le réflecteur ou une enceinte
- gardez le luminaire loin de matériaux qui peut brûler
- le luminaire ne peut être utilisé qu'avec des accessoires de Kreon

2 dimensions



Small Diapason LED

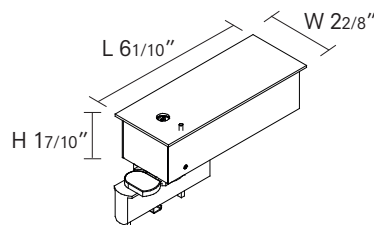


Diapason on-track gearbox

Name	Reference	Type	L x W x ϕ
Small Diapason on-Track	ku92640_	LED 8.4W 700mA	4" x 5 1/2" x ϕ 2 4/5"
Small Diapason on-Track	kx92640_	LED 8.4W 700mA	4" x 5 1/2" x ϕ 2 4/5"


input ku92640_ is 120Vin and the included driver is triac phase dimmable
input kx92640_ is 277Vin and is not dimmable

2 installation

provide Eutrac rail
120V systems: use Eutrac 230 track system
277V systems: use Eutrac 242 track system




turn the track connector in this position

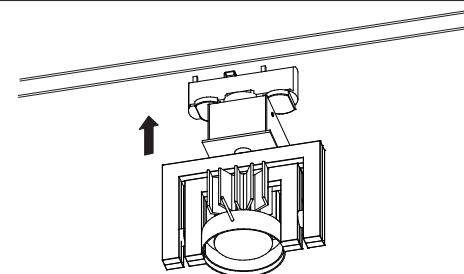


insert the luminaire into the track profile


3 installation

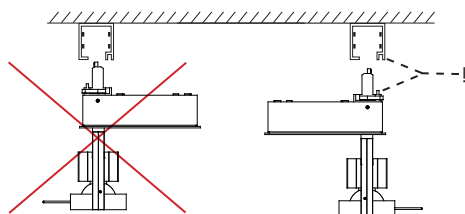

ensure the orientation
of the luminaire is correct

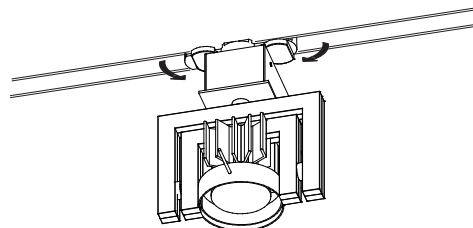

fix the luminaire by turning the handle
choose the correct circuit while making connection

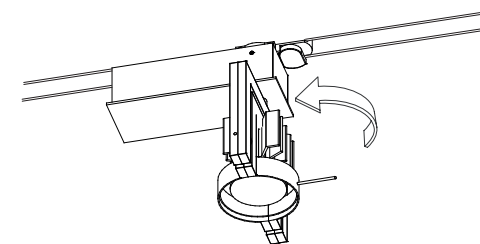

turn the gearbox parallel to the profile

